



An investigation on organic Rankine cycle incorporating a ground-cooled condenser: Working fluid selection and regeneration

Montaser Mahmoud ^{a, b}, Mohammad Alkhedher ^c, Mohamad Ramadan ^{b, d, *}, Sumsun Naher ^a, Keith Pullen ^a

^a Department of Engineering, School of Mathematics, Computer Science and Engineering, City, University of London, UK

^b Lebanese International University, PO Box 146404 Beirut, Lebanon

^c Mechanical Engineering Department, Abu Dhabi University, United Arab Emirates

^d International University of Beirut, PO Box 146404 Beirut, Lebanon



ARTICLE INFO

Article history:

Received 16 December 2021

Received in revised form

10 February 2022

Accepted 12 March 2022

Available online 16 March 2022

Keywords:

Shallow geothermal energy

Ground-cooled condenser

Power generation

Organic Rankine cycle

Ground heat exchanger

ABSTRACT

This research presents an optimization of a power generation system incorporating a ground-cooled condenser. It focuses on the mitigation of the adverse effects of critical parameters such as low mass flow rates and large ground loops. This includes an investigation of different configurations (basic and regenerative cycles) and working fluids to ascertain their effects on the performance of the system. Three refrigerants, R123, R124 and R245fa, were compared in terms of working fluid's performance. The purpose of the system optimization is to increase the net output power whilst reducing the capital cost of installation. At an inlet expander pressure of 3 MPa, as the condensation temperature was decreased from 25 °C to 15 °C the enhancements in net output power were 7.35%, 12.13% and 8.77% for R123, R124 and R245fa, respectively in the case of basic organic Rankine cycle. However, the highest performance in terms of net output power was recorded for R123 in both configurations under the investigated conditions. Based on the calculations of net output power and heat rejection, the regenerative cycle is highly recommended since it provides significant increase in the output power without considerably changing the amount of heat rejected to the ground.

© 2022 Elsevier Ltd. All rights reserved.

1. Introduction

Geothermal energy (GE) has been reported as one of the most stable renewable energy sources (RES) since it is almost independent of ambient air temperature. It is neither stochastic nor intermittent compared to other RES such as solar and wind energies [1,2]. The development of GE systems also encourages to decrease the dependency on fossil fuels and hence, mitigating the corresponding negative environmental effects [3]. Thus, investigating and improving GE systems support the global scope promoting sustainable energy and environmental protection [4,5]. GE is mainly classified into two types: deep and shallow. The former is typically used for direct heating or activating geothermal power plants (GPPs) [6,7]. Deep GE systems are very expensive, and they

are based on extracting hot geothermal fluid from deep underground layers [8,9]. The geothermal fluid will be reinjected back to the ground after being utilized. However, shallow GE can be used to provide heating or cooling via ground coupled heat exchangers [10]. Such systems could be found in the form of a ground source heat pump (GSHP) or earth air heat exchanger (EAHE). GSHP is based on the refrigeration cycle, while the ground is considered as the heating or cooling source instead of ambient air compared to the conventional air source heat pump [11,12]. Thus, it is necessary to use a ground heat exchanger (GHE) to transfer heat from/to the ground [13,14]. There are different types of GHE configurations such as vertical [15,16] and horizontal [17,18]. Coiled GHEs have also been considered as enhancements of the conventional types to decrease the volume of installations. These could be installed in the form of spiral [19] or slinky [20] shape. EAHE is simpler than that of GSHP since it only utilizes an underground duct to circulate air and supply it to the conditioned space via a blower [21,22].

Many previous studies have investigated the incorporation of geothermal energy in power generation systems using the ground

* Corresponding author. Lebanese International University, PO Box 146404 Beirut, Lebanon.

E-mail addresses: mohamad.ramadan@liu.edu.lb, dr.ramadan.mohamad@gmail.com (M. Ramadan).

Nomenclature

$\dot{Q}$	heat transfer rate (kW)
$\dot{W}$	power (kW)
$\dot{m}$	mass flow rate (kg/s)
ΔT_{lm}	logarithmic mean temperature difference
c_p	specific heat (kJ/kg.K)
h	enthalpy (kJ/kg)
η	efficiency
T	temperature (°C)
ε	effectiveness

Abbreviations

CTRC	CO ₂ -based transcritical Rankine cycle
DCV	directional control valve
EAHE	earth air heat exchanger
EES	Engineering Equation Solver

GE	geothermal energy
GHE	ground heat exchanger
GPP	geothermal power plant
GSHP	ground source heat pump
ORC	organic Rankine cycle
RES	renewable energy source

Subscripts

f	working fluid
g	gas
ge	generator
i	inlet
o	outlet
p	pump
r	regenerator
t	turbine
wp	water pump

as a source of heat [23]. Such applications utilize deep geothermal energy to activate dry steam [24], binary [25] and flash [26] power cycles depending on the available geothermal conditions. Dry steam and flash GPPs directly utilize the hot geothermal fluid to activate the power cycle. The difference between these cycles is that the geothermal fluid is available in the form of steam and mixture, respectively. While, in the binary cycle GPP, a heat exchanger is used to transfer heat from the geothermal fluid to the working fluid of the power cycle [27]. This cycle is mainly used in case of low-grade GE source. GPPs have also passed through several enhancements to improve the cycle's performance such as the double flash [28,29], combined flash-binary [30,31] and regenerative cycle [32,33]. However, it was also reported that shallow geothermal energy can be used as a cooling source for a power generation system [34,35]. The ground can provide a lower cooling medium temperature compared to that of ambient air, so that the condenser's pressure could be decreased accordingly. Thus, the net output power can be maximized since it depends mainly on the pressure difference between the gas heater and condenser. In Ref. [34], a new system was proposed incorporating a CO₂-based transcritical Rankine cycle with a ground-cooled condenser. The study covered a wide range of heat source conditions whilst varying the gas temperature from 500 °C to 1500 °C and mass flow rate from 100 to 350 kg/h. The aim of the study was to maximize the net output power of the cycle considering minimum heat exchangers lengths. Vidhi et al. [35] investigated the use of EAHE as a condenser in power plants at low to medium temperature heat sources. The power plant considered in the study was the supercritical Rankine cycle covering heat source temperatures ranging between 125 °C and 175 °C. The heat exchanger was buried under the ground at a depth of 2 m. The EAHE was able to increase the efficiency of the supercritical Rankine cycle by 1% and reduce the daily power fluctuations.

The aim of this paper is to compare the basic and regenerative organic Rankine cycle (ORC) incorporating a ground-cooled condenser. It includes investigating the effect of cycle's conditions and working fluid on the power cycle's performance. The most important parameter studied is the change in condensation temperature since it represents the effect of using the ground-cooled condenser on the cycle's performance. The amount of heat rejected to the ground is also a crucial parameter that needs to be taken into consideration to avoid large ground loop installations. Fig. 1 shows the different applications of shallow and deep GE whilst

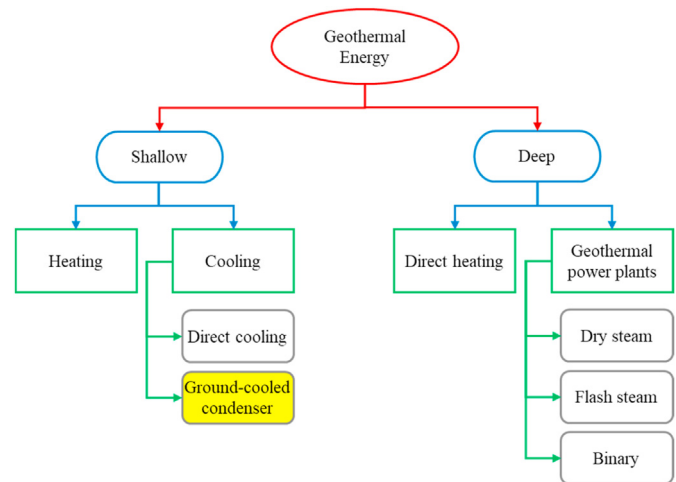


Fig. 1. Shallow and deep geothermal energy applications.

highlighting the system studied in the current work.

2. Ground-cooled condenser

The aim of installing a ground-cooled condenser is to extract more amount of power from a low-grade heating source (see Fig. 2). The ground provides a better cooling medium than ambient air especially in summer when the latter temperatures are relatively high. The enhancement in the cycle's net output power is displayed in Fig. 2b showing the increase in the working fluid's expansion between states 1 and 2.

The heat rejected from a power cycle can be relatively massive with respect to the shallow ground heat exchanger cooling capacity, otherwise a large installation would be required. This causes additional expenses making the system inappropriate for such utilizations. For this reason, it is better to integrate another cooling source into the proposed system such as an air-cooled or water-cooled heat exchanger to operate as a primary heat rejector (see Fig. 3). Another advantage of this integration is to provide coolth compensation to the ground heat exchanger in which this can immensely enhance its performance during operating hours. GE-

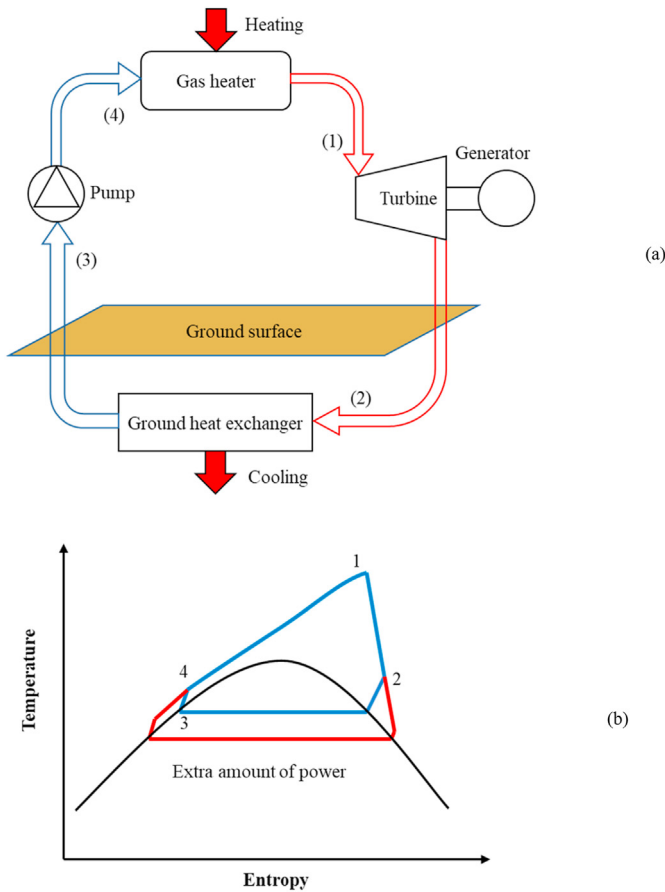


Fig. 2. CO₂-based transcritical Rankine cycle combined with a ground-cooled condenser; (a) components and (b) temperature-entropy diagram.

based hybrid systems have been frequently investigated by researchers since they offer various advantages compared to GE individual systems [36]. They are mainly used to reduce the capital cost of installation and to avoid ground thermal imbalance (heat accumulation or thermal depletion). However, most of these hybrid systems are used for heating or power generation by combining GE and solar energy subsystems [37,38].

The proposed cooling system has four operating modes that are controlled by the directional control valves (DCVs). Three of these modes are used when the power cycle is activated such that one or both heat exchangers can be operating depending on the ambient and ground temperatures. In most cases, the coolant (water) should pass through the primary heat exchanger before entering the GHE unless the ambient air temperature is higher than that of water at state 5. However, if the ground temperature is higher than that of ambient air, then the GHE must be overtaken. The fourth mode could be used only when the power cycle is turned off and the ambient air temperature is lower than that of the ground which mainly occurs during night hours. This is a coolth recovery mode used to extract heat from the ground such that water flows through both heat exchangers without entering the hybrid-cooled condenser.

The model used in Ref. [34] for calculating the CO₂-based transcritical Rankine cycle (CTRC) performance is also considered in the current study that was developed in Engineering Equation Solver (EES). The thermodynamic performance of the cycle depends mainly on the gas and power cycle's conditions (mass flow rate, temperatures, and pressures). The net output power can be

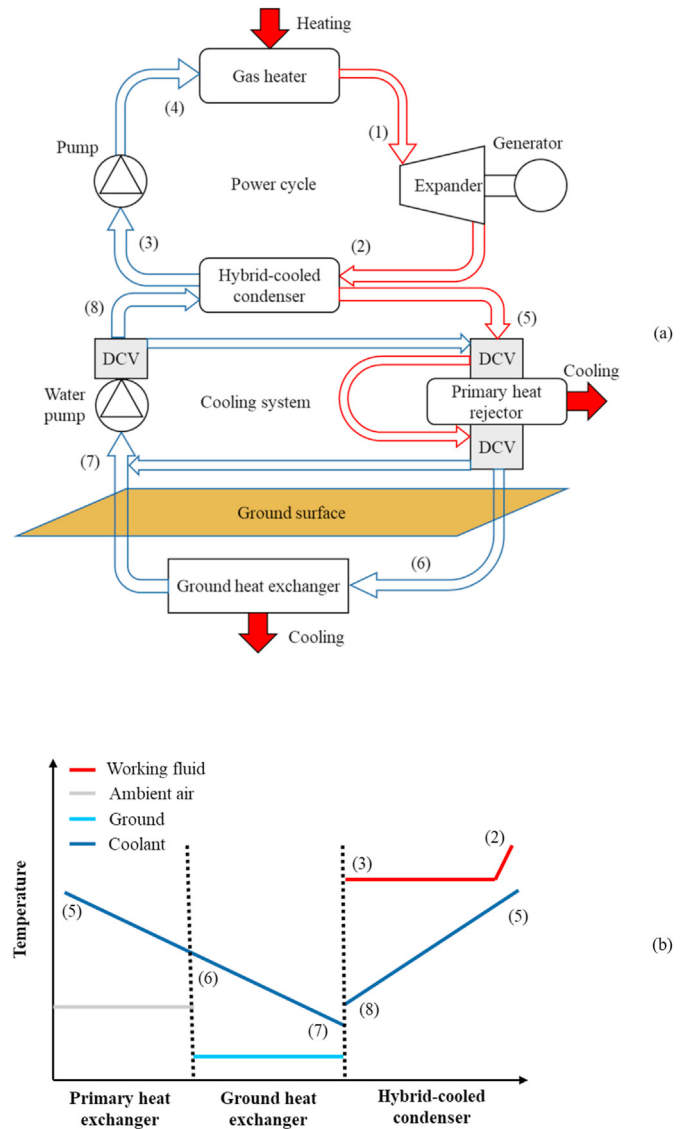


Fig. 3. (a) Schematic diagram of the optimized system and (b) temperature variation in the cooling system; directional control valve (DCV).

calculated by:

$$\dot{W}_{net} = \dot{W}_t \cdot \eta_{ge} - \dot{W}_p - \dot{W}_{wp} \quad (1)$$

where $\dot{W}_t$ is the turbine power, η_{ge} is the generator efficiency (90%), $\dot{W}_p$ is the pump power, and $\dot{W}_{wp}$ is the power demand of the water pump. The current study focuses on small scale power cycles which will be noticed from the resulting low net output power. This makes it necessary to replace the turbo expander with a scroll expander which better fits such applications [39]. This is crucial to avoid inefficient expansions in small turbines that operate at very high rotational speeds. In such cases (below 10 kW), the scroll expander efficiency is almost always considered as ~70%. $\dot{W}_t$ and $\dot{W}_p$ mainly depend on the mass flow rate of the working fluid and the enthalpy variation as shown in equations (2) and (3). The isentropic efficiency of the pump is considered as 80% [34].

$$\dot{W}_t = \dot{m}_f (h_1 - h_2) \quad (2)$$

$$\dot{W}_p = \dot{m}_f(h_4 - h_3) \quad (3)$$

Equations (4) and (5) show the methods used for evaluating the cycle's efficiency and heat added to the cycle, respectively:

$$\eta = \frac{\dot{W}_{net}}{\dot{Q}_{in}} \quad (4)$$

$$\dot{Q}_{in} = \dot{m}_g c_{pg}(T_{gi} - T_{go}) = \dot{m}_f(h_1 - h_4) \quad (5)$$

where $\dot{Q}_{in}$ is the heat extracted from the hot gas and added to the cycle's gas heater. The value of heat added is based on the specific heat (c_{pg}), flow rate ($\dot{m}_g$) and temperatures of hot gas (T_{gi} and T_{go}).

The methodology followed to evaluate the states of the proposed system is as follows:

- Considering a minimum temperature difference between the cooling source and the working fluid's condensation temperature.
- The states of coolant passing through the cooling system (5, 6, 7 and 8) can be calculated based on the ambient air and ground temperatures depending on the operating mode as mentioned previously in this section.
- Evaluating the low pressure of the power cycle and the enthalpy of the working fluid exiting the condenser (state 3).
- Considering the highest pressure of the cycle, state 4 can be calculated based on the isentropic efficiency of the pump (80%).
- At a given expander inlet pressure (state 1), the temperature will be chosen depending on the resulting net output power.
- Calculating the mass flow rate of the working fluid based on the energy balance in the gas heater as shown in equation (5).

3. Working fluids

The CO₂-based transcritical Rankine cycle presented in Fig. 2a was used only as a reference system to investigate the potential of ground-cooled condenser. This section describes the methodology followed to select the most suitable working fluid for the optimized system displayed in Fig. 3. Low to medium-grade sources of energy are considered in this study. Such sources require the adoption of ORC instead of the conventional steam Rankine cycle and this is mainly due to the low flow rate of water resulting in inefficient expansions and requirement for small turbines operating at high rotational speeds [40]. Even though, steam power cycle can theoretically generate more power in some cases, but it is not applicable to use it when the net output power is very low as will be presented in this research. Thus, it would not be economically feasible to adopt a Rankine cycle under the investigated conditions.

3.1. Characteristics of suitable working fluids

Firstly, to select the best working fluid, it is necessary to carry out parametric studies to compare the different useable working fluids. Choosing the fluid corresponding to the highest net output power and efficiency is not always the optimal method since it is essential to be aware of critical drawbacks and negative effects. These may include toxicity, flammability, and global warming potential. There are some other issues that are related to the fluid's nature like requiring high pressures to operate optimally or low flow rate. 1,1,2-Trichloro-1,2,2-trifluoroethane (R113) presents a good example of organic fluids that can produce high amount of power, while it is unfavorable due to its negative effect on public

health and ozone layer. For these reasons and according to previous investigations, three compatible refrigerants will be compared in terms of performance that are 2,2-Dichloro-1,1,1-trifluoroethane (R123), 1-Chloro-1,2,2,2-tetrafluoroethane (R124) and 1,1,1,3,3-Pentafluoropropane (R245fa). However, CO₂ is also included in this comparison only to represent the results related to the reference system presented in Ref. [34]. After stating the negative effects of unsuitable working fluids, it is also important to mention the factors that encourage using the convenient fluids. The most important factors are mainly the availability, cost, and performance. These are the main reasons for choosing the mentioned refrigerants in this parametric study. The methodology used to choose the best working fluid can be represented by the following points:

- Proposing different working fluids based on their availability and cost.
- Studying the negative effects of the proposed working fluids.
- Eliminating the unacceptable fluids based on their environmental impacts.
- Investigating the best point temperature of each working fluid.
- Investigating the relation between best point temperature and cycle's conditions.
- Comparing the working fluid's performance regarding net output power.
- Examining the flow rate of the best working fluid to check if it is feasible for an expander. At this stage, using water as a working fluid (Rankine cycle) would be eliminated.

Table 1 presents the IUPAC names of the investigated working fluids in addition to their critical temperatures and pressures.


3.2. Effect of energy grade source

Each working fluid has optimal operating conditions in which these depend mainly on the available grade source of energy (flow rate and temperature). In this section, the mass flow rate of gas, expander inlet pressure and condensation temperature are kept constant at 200 kg/h, 10 MPa and 25 °C, respectively. Fig. 4 shows the variation of net output power resulting from the compared working fluids as function of expander inlet temperature at gas temperatures of 300 °C and 600 °C. The gap presented in Fig. 4a corresponds to the unsuitability of refrigerants at these conditions such that the lowest temperature of operation depends directly on the expander inlet pressure. Thus, it would be better to decrease the pressure to ensure the superheating of working fluid at low temperatures. It is essential to ensure that the fluid exiting the expander is in vapor state otherwise it will not be possible to operate properly, and the expander blades will be damaged with time. This is also better considering lower pressures inside the pipes and hence minimizing the required thickness and preventing leakage. This is the first reason that makes the refrigerants preferable with respect to CO₂. Another advantage is the high extracted power compared to CO₂ in which all investigated refrigerants show better performances with noticeable differences (see Fig. 4). Among the studied working fluids, R123 presented the highest net output power at the different gas and expander inlet temperatures. In the next sections, CO₂ will be removed from the comparative study due the observed significant difference compared to other working fluids since this research focuses more on the thermodynamic and economical aspects. However, CO₂ would be an alternative solution if there are high restrictions since it is more environmentally benign. Thus, it is also important to develop the CO₂-based transcritical Rankine cycle incorporating a ground-cooled condenser investigated in Ref. [34].

Table 1


The critical temperatures and pressures of the working fluids investigated.

Working fluid	IUPAC name	Critical temperature (°C)	Critical pressure (kPa)
CO ₂	Carbon dioxide	30.98	7377
R123	2,2-Dichloro-1,1,1-trifluoroethane	183.7	3668
R124	1-Chloro-1,2,2,2-tetrafluoroethane	122.3	3624
R245fa	1,1,1,3,3-Pentafluoropropane	154	3651

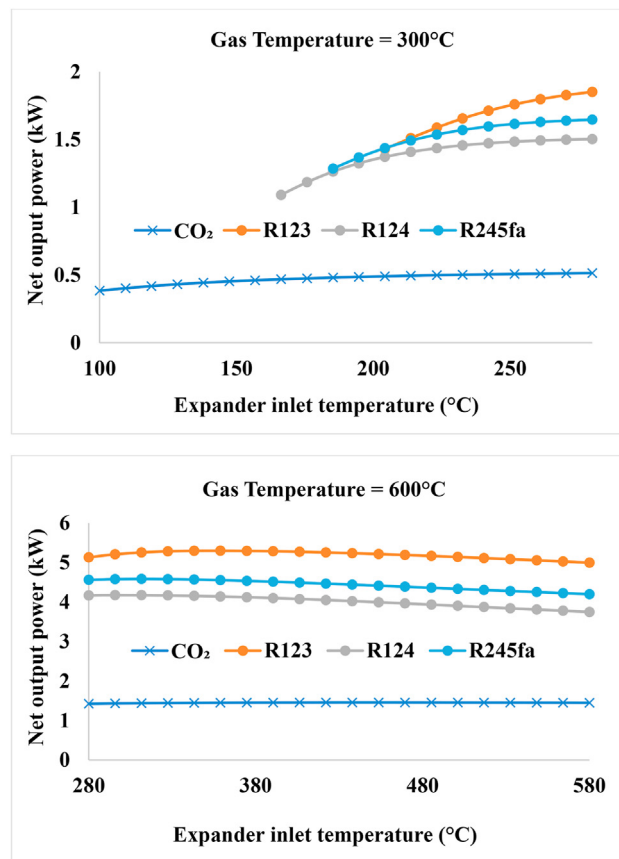**Fig. 4.** Effect of expander inlet temperature on the performance of working fluids at gas temperature of (a) 300 °C and (b) 600 °C.

3.3. Optimal operating temperature

After eliminating CO₂ from the possible working fluid choices, it is better to decrease the cycle's highest pressure. This is mainly because the chosen refrigerants can operate properly at low pressures and especially at low grade sources of energy. The gas flow rate, gas temperature and condensation temperature are maintained at 200 kg/h, 600 °C and 25 °C respectively in this section. The optimal operating temperatures of the refrigerants are presented in Fig. 5 in which it can be noticed that the best point temperature can vary with the change in the expander inlet pressure. This temperature is more noticeable at 3 MPa such that it is recorded as 131.6 °C, 163.2 °C and 184.2 °C for R124, R245fa and R123, respectively. This shows that the refrigerant that has higher critical temperature requires higher operating temperature to achieve its optimal performance (see Table 1). Fig. 5 shows that when the expander inlet pressure increases from 3 to 6 MPa, the curves become smoother which means that the variation in expander inlet temperature is more effective at low pressures. This makes the choice of operating temperature more critical at low grade sources

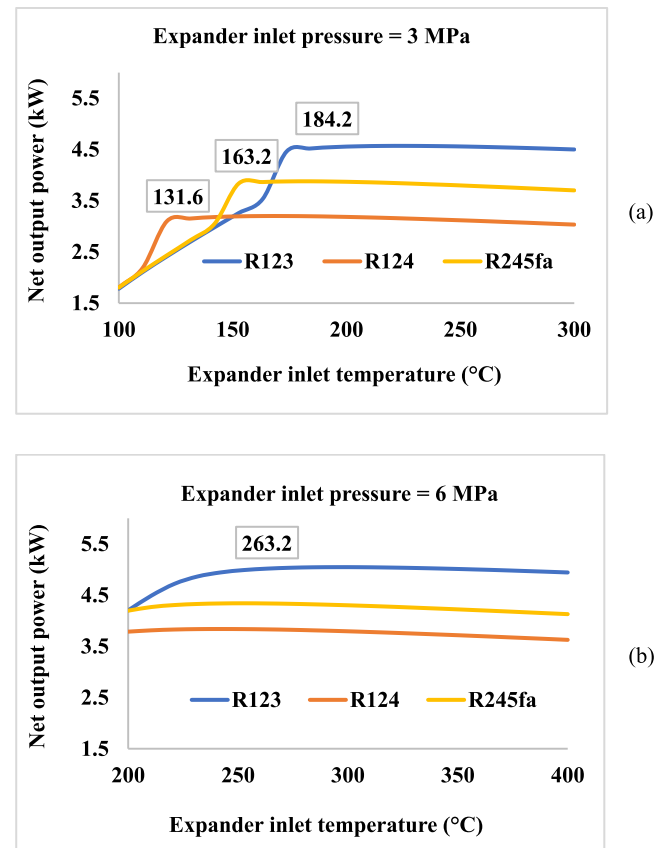**Fig. 5.** The best point temperature of investigated working fluids at a condensation temperature of 25 °C and expander inlet pressure of (a) 3 MPa and (b) 6 MPa.

of energy because it will not be possible to increase the expander inlet pressure. According to this comparison, R123 still corresponds to the highest performance at low expander inlet pressures achieving net output power of 4.57 kW at 3 MPa and 5.046 kW at 6 MPa. This is another reason for making R123 suitable for low grade applications since there is no significant difference between the net output power at the different studied pressures.

3.4. Effect of condensation temperature

The aim of investigating the ground-cooled condenser presented in Ref. [34] was to decrease the condensation temperature to increase the difference between the low and high cycle's pressures. Consequently, this has helped improving the system's efficiency and net output power due to the increase in working fluid's expansion in the expander. To study the effect of using ground-cooled condenser (decreasing the condensation temperature), the values considered in the previous section are kept the same whilst only changing the condensation temperature from 25 °C to 15 °C.

The results are presented in Fig. 6 in which R123 generates the highest net output power with highest values of 5.367 kW at 3 MPa and 5.615 kW at 6 MPa. In comparison with the results presented in Fig. 5, the corresponding enhancements are 7.35% and 6.36%. This shows that the importance of using ground-cooled condenser is more noticeable at low grade sources of energy.

Table 2 shows the performance enhancements of all working fluids in terms of net output power. The highest enhancements are recorded by the refrigerant that has the lowest critical temperature which R124. However, the refrigerants with high critical temperatures that are R123 and R245fa still generate higher amounts of power at the investigated conditions. The highest enhancement recorded by R124 is also obtained at the low pressure (3 MPa) with a value of 12.13% representing the increase in net output power from 3.2 kW to 3.588 kW. These enhancements are still less than that reported in Ref. [34] for the CTTC which was approximately 30%. However, all these values present the enhancement in performance of each working fluid alone compared to its operation without using a ground-cooled condenser. Thus, it is still favorable to use the mentioned refrigerants since they can significantly produce more power than that of CTTC under the studied conditions as shown in Fig. 4.

4. Regenerative cycle

Adding a regenerator to the optimized system presented in Fig. 3 would be an attractive method to enhance the thermodynamic performance of the cycle and specially when there is a huge difference between the temperatures of states (2) and (4). The

regenerative cycle is depicted in Fig. 7 which aims to take advantage of the energy remaining in the working fluid exiting the expander. On the other hand, it is necessary to check out if there are any negative consequences associated with this integration such as the amount of heat rejected to the ground. In this section, the inlet and outlet heat source temperatures are maintained at 500 °C and 120 °C, respectively.

Fig. 8 presents the temperature-entropy diagram of the regenerative cycle showing the states of the organic Rankine cycle. It is essential to compare the temperatures entering and exiting the regenerator in all cases to ensure that the regeneration is applicable. This means that $T_{4'}$ must be always greater than T_4 as well as $T_{2'}$ must be greater than T_4 and T_3 . For this reason, in the upcoming sections, some points have been eliminated from the figures representing the results. This mainly depends on the thermodynamic properties of the investigated working fluids. The temperature difference between the working fluid entering the gas heater and that exiting the expander is assumed to be 30 °C to avoid the installation of large heat exchanger (regenerator).

Equation (6) presents the relation between the enthalpies of working fluid entering and exiting the regenerator. The effectiveness of regenerator (ϵ_r) is assumed to be 80%.

$$\epsilon_r = \frac{h_2 - h_{2'}}{h_{4'} - h_4} \quad (6)$$

where h_2 , $h_{2'}$, h_4 and $h_{4'}$ are the working fluid's enthalpies exiting the expander, entering the condenser, exiting the pump, and entering the gas heater, respectively. This equation aims to calculate the enthalpy at state (2') and hence to evaluate $T_{2'}$ considering a negligible pressure drop inside the regenerator.

4.1. Expander inlet temperature

The temperature of working fluid entering the expander (T_1) has a significant effect on the net output power of the regenerative cycle as shown in Fig. 9. The expander inlet pressure, condensation temperature and gas flow rate are maintained at 10 MPa, 25 °C and 200 kg/h, respectively. The net output power of the basic ORC is almost around 3.5 kW for all working fluids, however, that of the regenerative cycle has a sharp increase while increasing the expander inlet temperature from 200 °C to 400 °C. The effect of adding a regenerator is more considerable for R124 than R245fa and R123 at each specific temperature which can be noticed from the difference between the slopes. On the other hand, the unsuitability of regeneration occurs earlier for R124 and R245fa allowing R123 to reach the highest net output power of 8.86 kW at 386 °C. The corresponding values for R124 and R245fa are 7.27 kW and 8.07 kW at 312 °C and 344 °C, respectively.

The highest net output power of the basic ORC and regenerative cycles for the three working fluids is recorded and tabulated (see Table 3). The corresponding expander inlet temperatures vary between ORC and regenerative cycle as well as between the working fluids. For the regenerative cycle, the highest power is always achieved at the maximum allowable temperature.

4.2. Expander inlet pressure

To investigate the impact of expander inlet pressure on the cycle's performance, the expander inlet temperature, condensation temperature and gas flow rate are kept constant at 300 °C, 25 °C and 200 kg/h, respectively. It can be noticed from Fig. 10 that as the expander inlet pressure increases the net output power of basic ORC increases while that of regenerative cycle decreases for all working fluids. The highest performances are recoded as 6.83 kW

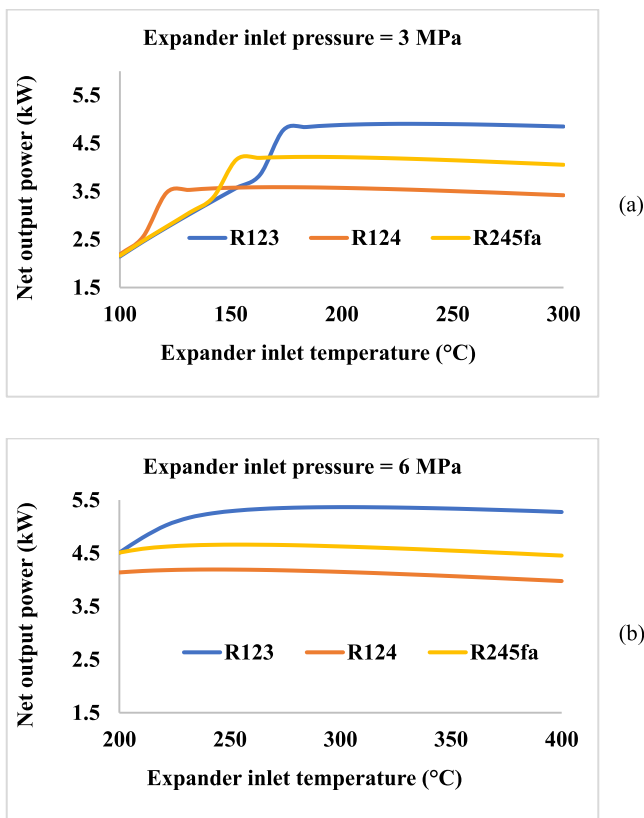


Fig. 6. The variation of net output power as a function of expander inlet temperature at a condensation temperature of 15 °C and expander inlet pressure of (a) 3 MPa and (b) 6 MPa.

Table 2
The enhancement of net output power when using ground-cooled condenser.

Working fluid	Net output power enhancement (%)	
	Expander inlet pressure: 3 MPa	Expander inlet pressure: 6 MPa
R123	7.35	6.36
R124	12.13	9.28
R245fa	8.77	7.37

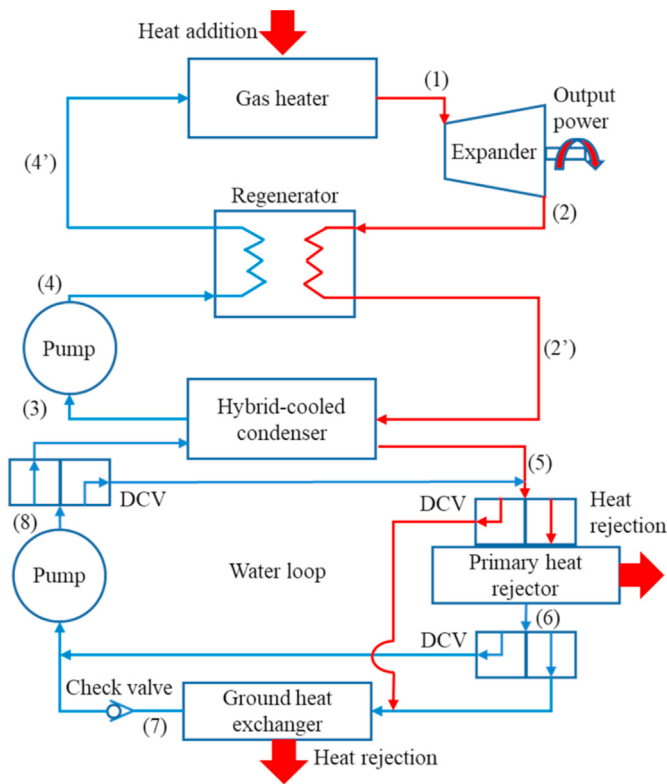


Fig. 7. Schematic diagram of the regenerative cycle.



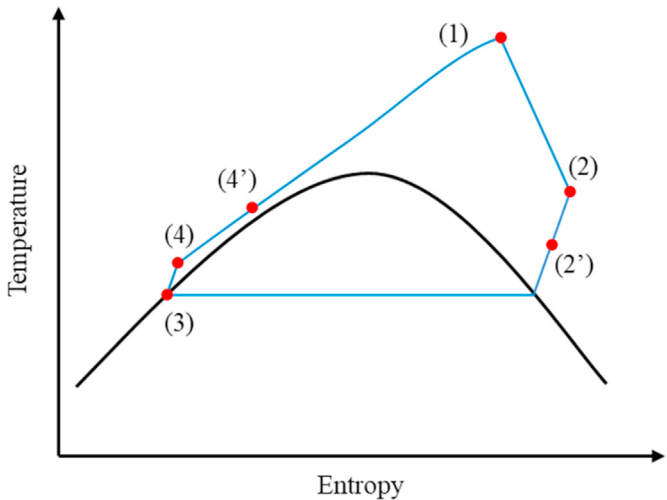


Fig. 8. Temperature-entropy diagram of the regenerative transcritical Rankine cycle.


for R123, 7.2 kW for R124 and 7.26 kW for R245fa. Even though, R245fa corresponds to the highest net output power, but R123 is

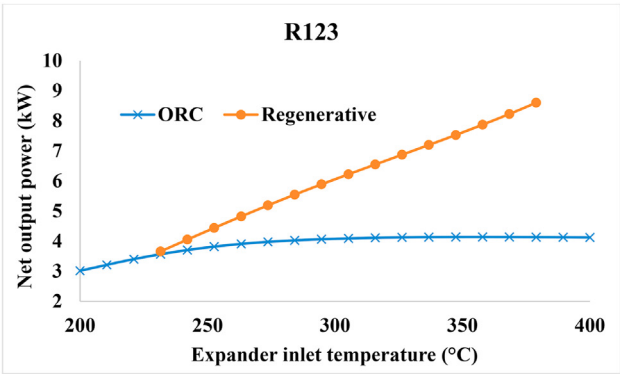

(a)

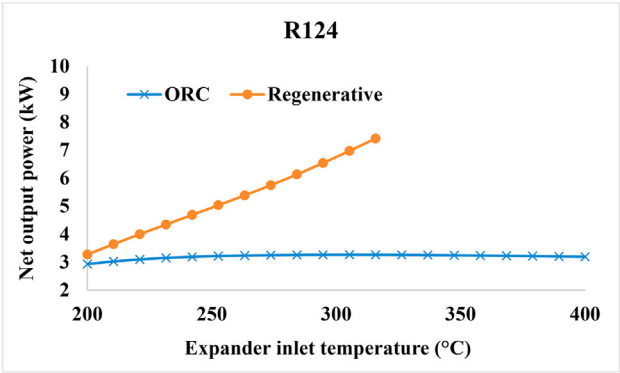

(b)

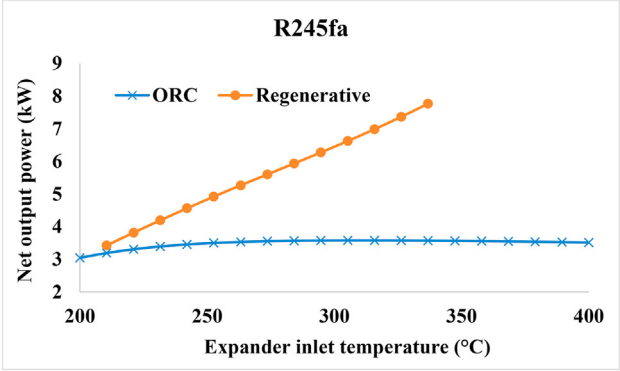


(c)


Fig. 9. Effect of expander inlet temperature on the net output power of basic and regenerative organic Rankine cycles for (a) R123, (b) R124 and (c) R245fa.

Table 3
The enhancement in net output power using a regenerative organic Rankine cycle.


Working fluid	Net output power (kW)	
	Organic Rankine cycle	Regenerative cycle
R123	4.14 @ 358 °C	8.86 @ 386 °C
R124	3.26 @ 305 °C	7.27 @ 312 °C
R245fa	3.58 @ 310 °C	8.07 @ 344 °C

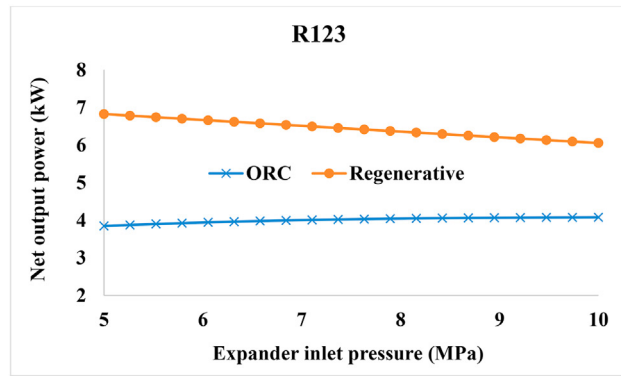

(a)

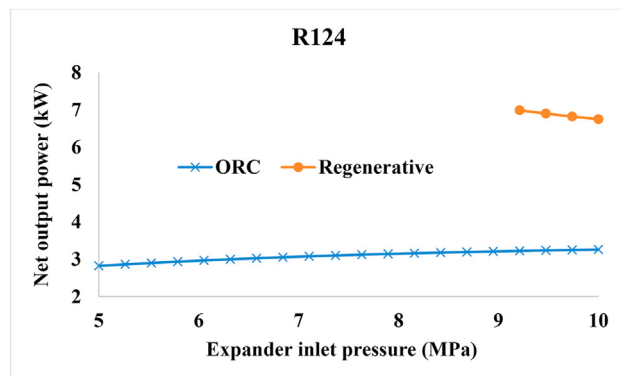


(b)

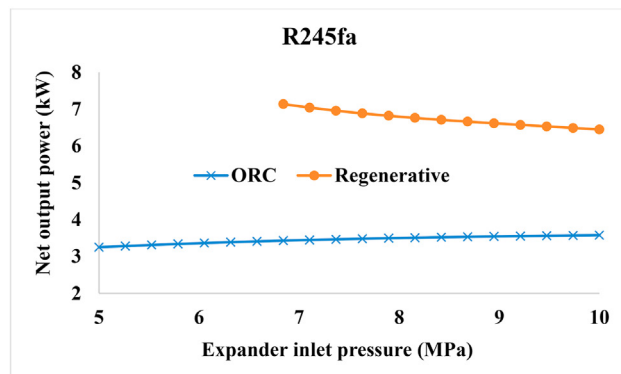


(c)

Fig. 10. Effect of expander inlet pressure on the net output power of basic and regenerative organic Rankine cycles for (a) R123, (b) R124 and (c) R245fa.


still the preferable working fluid. This is due to that R123 can operate at wide range of temperatures and pressures as shown in Figs. 9a and 10a. Another reason is that the results presented in Fig. 9 is obtained at an expander inlet temperature of 300 °C which is near to the best point temperature of R124 and R245fa (see Table 3). Thus, it would be possible to enhance the net output power of R123 by increasing the temperature (T_1). Additionally, R123 can operate at lower pressures than that of R124 and R245fa in case of regenerative cycle at the same expander inlet temperature. This makes R123 the favorable working fluid and specially because the net output power is still highly acceptable compared to R124 and R245fa when operating far from its optimal temperature at lower pressures. For R123, it can operate normally between 5 MPa and 10 MPa at an expander inlet temperature of 300 °C. However, for R124 and R245fa, the regenerative cycle is unsuitable for pressures lower than 9.1 MPa and 6.8 MPa, respectively.

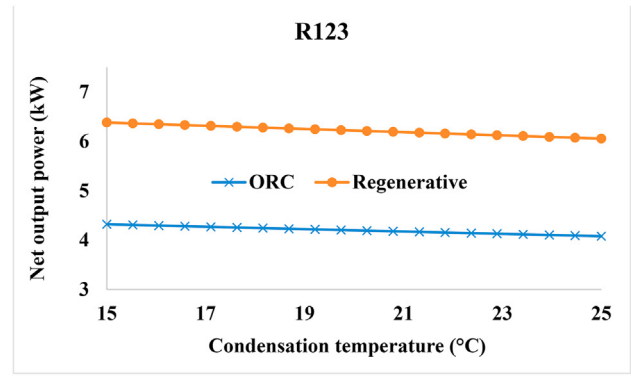

(a)

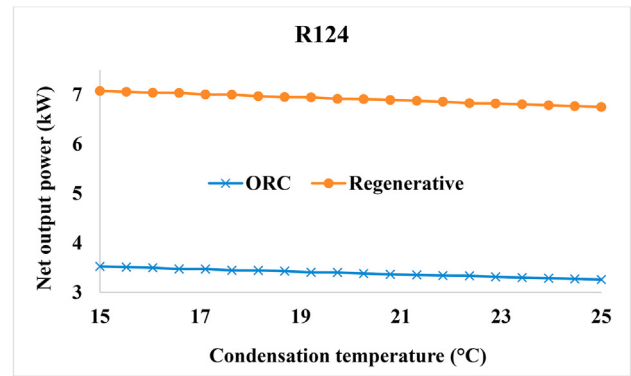

(b)

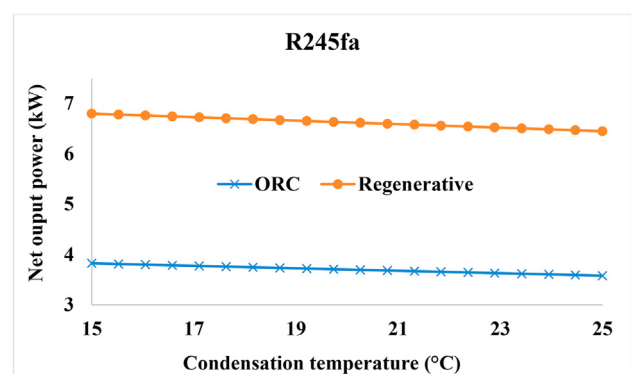

(c)

Fig. 11. Effect of condensation temperature on the net output power of basic and regenerative organic Rankine cycles for (a) R123, (b) R124 and (c) R245fa.

4.3. Condensation temperature

The variation of condensation temperature (T_3) affects the basic ORC and regenerative cycle almost in the same manner for all working fluids. Fig. 11 shows that as the condensation temperature increases from 15 °C to 25 °C the net output power of the cycles decreases by an amount of ~0.3 kW. The decrease in condensation temperature corresponds to the use of ground cooling system since the ground is responsible for heat removal. Thus, if this system is activated, and considering a condensation temperature drop from 25 °C to 15 °C, the enhancement of net output power for regenerative R123, R124 and R245fa can be estimated as 5.4%, 4.8% and 5.4%, respectively. This shows that the ground cooling system is more effective for R123 and R245fa than that of R124 regenerative ORCs.

4.4. Flow rate of heat source

According to the energy balance inside the gas heater, the following equation can be used to represent the relation between heat source gas and ORC's working fluid in case of a regenerative cycle:

$$\dot{m}_g \cdot c_{pg} (T_{gi} - T_{go}) = \dot{m}_f (h_1 - h_{4'}) \quad (7)$$

where $\dot{m}_g$, T_{gi} , T_{go} , $\dot{m}_f$, h_1 and $h_{4'}$ are the gas flow rate, gas specific heat, gas inlet temperature, gas outlet temperature, working fluid's mass flow rate, enthalpy at state (1) and enthalpy at state (4'), respectively. It is obvious that the flow rates of heat source and working fluid are directly proportional. This relation can be observed in Fig. 12 such that both flow rates vary similarly in ORC and regenerative cycle for all working fluids. However, the slope of curve corresponding to the regenerative cycle is greater than that of

basic ORC showing that the regeneration approach is more attractive at high heat source flow rates. The mass flow rate of working fluid in the regenerative cycle is always higher than that of ORC revealing the results presented in Figs. 9, Figs. 10 and 11. Therefore, the increase in net output power is mainly due to the increase in the working fluid's mass flow rate that is affected by the enthalpy change at the gas heater's inlet. Based on equation (7), if the enthalpy of the working fluid entering the gas heater increases, the mass flow rate will also increase. So, by comparing the basic ORC and regenerative cycle, the enthalpy has increased from state (4) to (4') resulting in an increase in the working fluid's mass flow rate.

4.5. Heat rejection

From the previous sections, the increase in working fluid's mass flow rate has been considered as an advantage to enhance the overall cycle's thermodynamic performance. On the other hand,

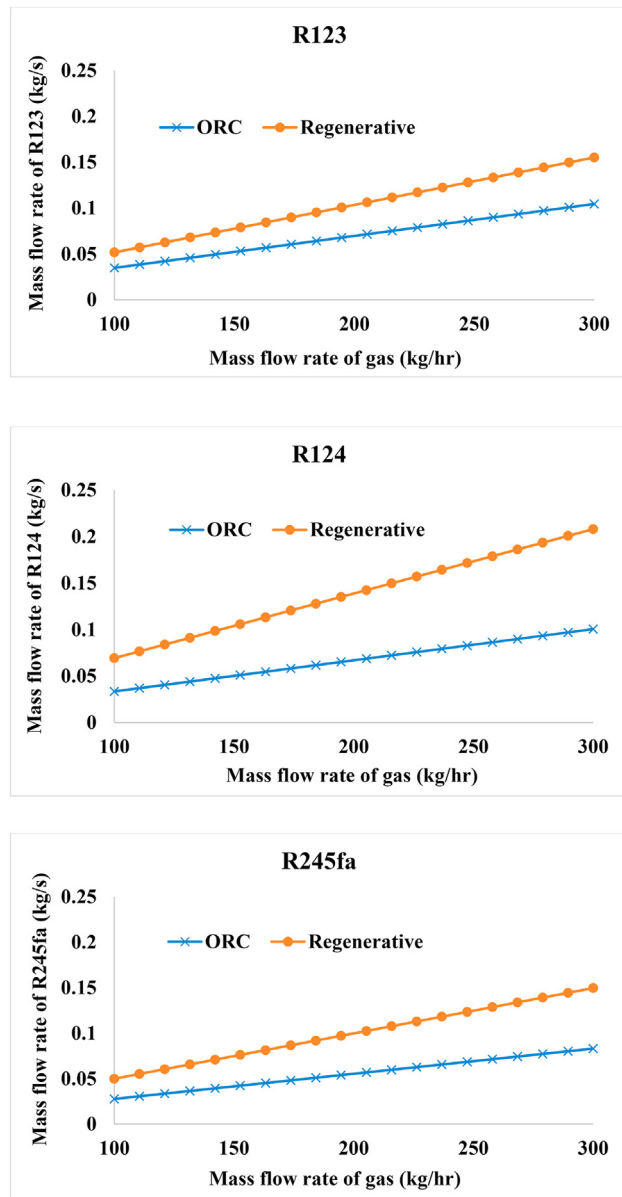


Fig. 12. The relation between mass flow rate of heat source and working fluids in basic and regenerative organic Rankine cycles for (a) R123, (b) R124 and (c) R245fa.

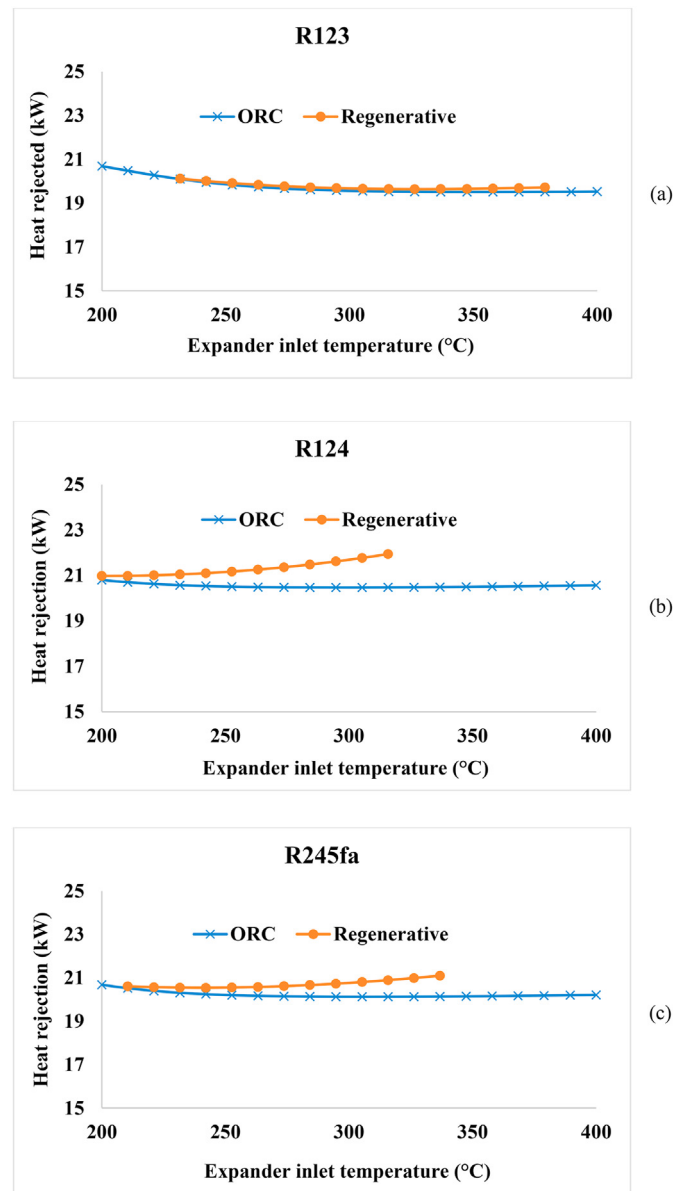


Fig. 13. The influence of regenerator on the heat rejected to the ground for (a) R123, (b) R124 and (c) R245fa.

Table 4

The optimum performance of investigated working fluids.

Working fluid	Net output power (kW)	Efficiency (%)	Expander inlet temperature (°C)	Heat rejection (kW)
R123	9.1	37.7	385	19.2
R124	7.5	31.0	310	21.1
R245fa	8.3	34.3	342	20.5

this may cause negative impact on the ground loop resulting in a larger ground heat exchanger which mainly depends on the amount of heat rejected from the cycle. Equation (8) is used to estimate the heat transferred from the regenerative ORC to the ground.

$$\dot{Q}_{rej} = \dot{m}_f(h_2 - h_3) \quad (8)$$

The amount of heat rejected from the cycle is presented in Fig. 13 for the three investigated working fluids as a function of the expander inlet temperature. It can be noticed that the effect of adding a regenerator on the amount of heat rejected from the cycle is more considerable for R124 and R245fa than that for R123. This is clearly presented from the gap between the curves corresponding to ORC and regenerative cycle. The heat rejected in case of R124 and R245fa increases slightly from 20.98 to 21.94 kW and 20.66–21.18 kW, respectively while that of R123 decreases from 20.16 to 19.72 kW. This makes R123 also more attractive and especially because the highest net output power is achieved at high expander inlet temperatures (see Fig. 9) while the heat rejected is less than that of other fluids by approximately 2 kW.

4.6. Summary

The performance of working fluids varies significantly under the investigated conditions as presented in the previous sections. The effect of using the ground-based cooling system (decrease in condensation temperature) can be considered as an attractive approach to enhance the efficiency and extract more power from a Rankine cycle and especially in case of low-grade energy sources. Table 4 summarizes the optimum performance of the three investigated working fluids in terms of net output power, efficiency, and heat rejection as well as the corresponding expander inlet temperature. These results have been recorded at an expander inlet pressure and condensation temperature of 10 MPa and 15 °C, respectively.

5. Conclusions

A comparison between three working fluids was carried out that are R123, R124 and R245fa. Each working fluid has an optimal operating temperature at a given expander inlet pressure. It was shown that as the critical temperature increased the best point temperature also increased. As the pressure changed from 3 MPa to 6 MPa, the optimal expander inlet temperature for R123 was shifted from 184.2 °C to 263.2 °C. After performing the parametric and comparative studies, it is seen that R123 is the best suitable working fluid under the investigated conditions. This has been recorded for the basic ORC and regenerative cycle. In case of the basic ORC, the effect of decreasing the condensation temperature was more considerable for low expander inlet pressures and working fluids with low critical temperatures. At 3 MPa, as the condensation temperature was decreased from 25 °C to 15 °C the enhancements in net output power were 7.35%, 12.13% and 8.77% for R123, R124 and R245fa, respectively. In contrast, the effect of using the ground-cooled condenser was more significant at high expander inlet pressures in the regenerative cycle. R123 is not only

preferable due to the corresponding thermodynamic performance, but it also resulted in the lowest amount of heat rejected to the ground as well as it can operate at wide range of pressures and temperatures. The latter reason makes the cycle more flexible while using R123 as a working fluid allowing it to operate normally at different heat source conditions. Thus, R123 will be considered as working fluid in future work to investigate a real application to check the feasibility of the system in terms of performance and cost. It is recommended to adopt the regenerative cycle in the case studied for the ground cooling system since it increased the net output power immensely without significantly affecting the amount of heat rejected to the ground. This means that adopting the regenerative cycle will not considerably increase the required ground heat exchanger size.

Declaration of competing interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

References

- [1] Mahmoud Montaser, Ramadan Mohamad, Abdul-Ghani Olabi, Keith Pullen, Naher Sumsun. A review of mechanical energy storage systems combined with wind and solar applications. *Energy Convers Manag* 2020;210:112670. <https://doi.org/10.1016/j.enconman.2020.112670>. ISSN 0196-8904.
- [2] Ahmad Tanveer, Zhang Dongdong, Huang Chao. Methodological framework for short-and medium-term energy, solar and wind power forecasting with stochastic-based machine learning approach to monetary and energy policy applications. *Energy* 2021;231:120911. <https://doi.org/10.1016/j.energy.2021.120911>. ISSN 0360-5442.
- [3] Mahmoud Montaser, Ramadan Mohamad, Naher Sumsun, Keith Pullen, Abdul-Ghani Olabi. The impacts of different heating systems on the environment: a review. *Sci Total Environ* 2021;766:142625. <https://doi.org/10.1016/j.scitotenv.2020.142625>. ISSN 0048-9697.
- [4] Abdul Ghani Olabi. The 3rd international conference on sustainable energy and environmental protection SEEP 2009 – guest Editor's Introduction. *Energy* 2010;35(Issue 12). <https://doi.org/10.1016/j.energy.2010.09.053>. 4508-4509, ISSN 0360-5442.
- [5] Olabi AG. 100% sustainable energy. *Energy* 2014;77:1–5. <https://doi.org/10.1016/j.energy.2014.10.083>. ISSN 0360-5442.
- [6] Shamoushaki Moein, Fiaschi Daniele, Manfrida Giampaolo, Talluri Lorenzo. Energy, exergy, economic and environmental (4E) analyses of a geothermal power plant with NCGs reinjection. *Energy* 2021;122678. <https://doi.org/10.1016/j.energy.2021.122678>. ISSN 0360-5442.
- [7] Chen Heng, Wang Yihan, Li Jiarui, Xu Gang, Lei Jing, Tong Liu. Thermodynamic analysis and economic assessment of an improved geothermal power system integrated with a biomass-fired cogeneration plant. *Energy* 2021;122477. <https://doi.org/10.1016/j.energy.2021.122477>. ISSN 0360-5442.
- [8] Limberger Jon, Boxem Thijs, Pluymaekers Maarten, Bruhn David, Manzella Adele, Calcagno Philippe, Beekman Fred, Cloetingh Sierd, Jan-Diederik van Wees. Geothermal energy in deep aquifers: a global assessment of the resource base for direct heat utilization. *Renew Sustain Energy Rev* 2018;82(Part 1):961–75. <https://doi.org/10.1016/j.rser.2017.09.084>. ISSN 1364-0321.
- [9] Huculak Maciej, Jarczewski Wojciech, Dej Magdalena. Economic aspects of the use of deep geothermal heat in district heating in Poland. *Renew Sustain Energy Rev* 2015;49:29–40. <https://doi.org/10.1016/j.rser.2015.04.057>. ISSN 1364-0321.
- [10] Kumar Soni Suresh, Pandey Mukesh, Nath Bartaria Vishvendra. Ground coupled heat exchangers: a review and applications. *Renew Sustain Energy Rev* 2015;47:83–92. <https://doi.org/10.1016/j.rser.2015.03.014>. ISSN 1364-0321.
- [11] Weeratunge Hansani, Aditya Gregorius Riyan, Simon Dunstall, de Hoog Julian, Narsilio Guillermo, Halgamuge Saman. Feasibility and performance analysis of hybrid ground source heat pump systems in fourteen cities. *Energy* 2021;234:

121254. <https://doi.org/10.1016/j.energy.2021.121254>. ISSN 0360-5442.
- [12] Deng Yan, Liu Yicai, Zeng Rong, Wang Qianxu, Zheng Li, Zhang Yu, Liang Heng. A novel operation strategy based on black hole algorithm to optimize combined cooling, heating, and power-ground source heat pump system. *Energy* 2021;229:120637. <https://doi.org/10.1016/j.energy.2021.120637>. ISSN 0360-5442.
- [13] Liang Bin, Chen Meiqian, Orooji Yasin. Effective parameters on the performance of ground heat exchangers: a review of latest advances. *Geothermics* 2022;98:102283. <https://doi.org/10.1016/j.geothermics.2021.102283>. ISSN 0375-6505.
- [14] Zeng Shu, Yan Zhenguo, Yang Jun. Review and forecast of ground heat exchangers development: a bibliometric analysis from 2001 to 2020. *Sustain Energy Technol Assessments* 2021;47:101547. <https://doi.org/10.1016/j.seta.2021.101547>. ISSN 2213-1388.
- [15] Pan Aiqiang, McCartney John S, Lu Lin, Tian You. A novel analytical multilayer cylindrical heat source model for vertical ground heat exchangers installed in layered ground. *Energy* 2020;200:117545. <https://doi.org/10.1016/j.energy.2020.117545>. ISSN 0360-5442.
- [16] Ahmadfard Mohammadamin, Bernier Michel. A review of vertical ground heat exchanger sizing tools including an inter-model comparison. *Renew Sustain Energy Rev* 2019;110:247–65. <https://doi.org/10.1016/j.rser.2019.04.045>. ISSN 1364-0321.
- [17] Hou Gaoyang, Taherian Hessam, Song Ying, Jiang Wei, Chen Diyi. A systematic review on optimal analysis of horizontal heat exchangers in ground source heat pump systems. *Renew Sustain Energy Rev* 2022;154:111830. <https://doi.org/10.1016/j.rser.2021.111830>. ISSN 1364-0321.
- [18] Bordignon S, Carnieletto L, Zarrella A. An all-in-one machine coupled with a horizontal ground heat exchanger for the air-conditioning of a residential building. *Building and Environment*; 2021. p. 108558. <https://doi.org/10.1016/j.buildenv.2021.108558>. ISSN 0360-1323.
- [19] Yoon Seok, Kim Min-Jun, Jeon Jun-Seo, Jung Yong-Bok. Significance evaluation of performance factors on horizontal spiral-coil ground heat exchangers. *J Build Eng* 2021;35:102044. <https://doi.org/10.1016/j.jobee.2020.102044>. ISSN 2352-7102.
- [20] Larwa Barbara, Kupiec Krzysztof. Determination of pipe wall temperature in a slinky-coil ground heat exchanger. *Int J Heat Mass Tran* 2020;160:120202. <https://doi.org/10.1016/j.jheatmasstransfer.2020.120202>. ISSN 0017-9310.
- [21] Nemati Nasibeh, Omidvar Amir, Rosti Behnam. Performance evaluation of a novel hybrid cooling system combining indirect evaporative cooler and earth-air heat exchanger. *Energy* 2021;215(Part B):119216. <https://doi.org/10.1016/j.energy.2020.119216>. ISSN 0360-5442.
- [22] Liu Zhengxuan, Yu Zhun (Jerry), Yang Tingting, Roccamena Letizia, Sun Pengcheng, Li Shuisheng, Zhang Guoqiang, El Mankibi Mohamed. Numerical modeling and parametric study of a vertical earth-to-air heat exchanger system. *Energy* 2019;172:220–31. <https://doi.org/10.1016/j.energy.2019.01.098>. ISSN 0360-5442.
- [23] Mahmoud Montaser, Ramadan Mohamad, Naher Sumsun, Keith Pullen, Ali Abdelkareem Mohammad, Olabi Abdul-Ghani. A review of geothermal energy-driven hydrogen production systems. *Therm Sci Eng Prog* 2021;22:100854. <https://doi.org/10.1016/j.tsep.2021.100854>. ISSN 2451-9049.
- [24] Prananto Lukman Adi, Juangsa Firman Bagja, Iqbal Riza Mochamad, Aziz Muhammad, Soelaiman Tubagus Ahmad Fauzi. Dry steam cycle application for excess steam utilization: kamojang geothermal power plant case study. *Renew Energy* 2018;117:157–65. <https://doi.org/10.1016/j.renene.2017.10.029>. ISSN 0960-1481.
- [25] Nasruddin N, Saputra Irfan Dwi, Mentari Tania, Bardow André, Marcelina Olga, Susanto Berlin, Exergy, exergoeconomic, and exergoenvironmental optimization of the geothermal binary cycle power plant at Ampallas, West Sulawesi, Indonesia. *Therm Sci Eng Prog* 2020;19:100625. <https://doi.org/10.1016/j.tsep.2020.100625>. ISSN 2451-9049.
- [26] Hassani Mokarram N, Mosaffa AH. Investigation of the thermoeconomic improvement of integrating enhanced geothermal single flash with transcritical organic Rankine cycle. *Energy Convers Manag* 2020;213:112831. <https://doi.org/10.1016/j.enconman.2020.112831>. ISSN 0196-8904.
- [27] Niknam Pouriya H, Talluri Lorenzo, Fiaschi Daniele, Manfreda Giampaolo. Sensitivity analysis and dynamic modelling of the reinjection process in a binary cycle geothermal power plant of Larderello area. *Energy* 2021;214:118869. <https://doi.org/10.1016/j.energy.2020.118869>. ISSN 0360-5442.
- [28] Meng Dongyu, Liu Qiang, Ji Zhongli. Effects of two-phase expander on the thermoeconomics of organic double-flash cycles for geothermal power generation. *Energy* 2022;239(Part D):122346. <https://doi.org/10.1016/j.energy.2021.122346>. ISSN 0360-5442.
- [29] Amin Javadi Mohammad, Abhari Mani Khalili, Ghasemiasl Ramin, Ghomashi Hossein. Energy, exergy and exergy-economic analysis of a new multigeneration system based on double-flash geothermal power plant and solar power tower. *Sustain Energy Technol Assessments* 2021;47:101536. <https://doi.org/10.1016/j.seta.2021.101536>. ISSN 2213-1388.
- [30] Abdolalipouradl Mehran, Mohammadkhani Farzad, Khalilarya Shahram. A comparative analysis of novel combined flash-binary cycles for Sabalan geothermal wells: thermodynamic and exergoeconomic viewpoints. *Energy* 2020;209:118235. <https://doi.org/10.1016/j.energy.2020.118235>. ISSN 0360-5442.
- [31] Zhou Yuhong, Li Shanshan, Sun Lei, Zhao Shupeng, Seyed Saman Ashraf Talesh. Optimization and thermodynamic performance analysis of a power generation system based on geothermal flash and dual-pressure evaporation organic Rankine cycles using zeotropic mixtures. *Energy* 2020;194:116785. <https://doi.org/10.1016/j.energy.2019.116785>. ISSN 0360-5442.
- [32] Eyerer Sebastian, Dawo Fabian, Wieland Christoph, Spliethoff Hartmut. Advanced ORC architecture for geothermal combined heat and power generation. *Energy* 2020;205:117967. <https://doi.org/10.1016/j.energy.2020.117967>. ISSN 0360-5442.
- [33] Kazemi Shabnam, Mohamad Iskandr Mohamad Nor, Teoh Wen Hui. Thermodynamic and economic investigation of an ionic liquid as a new proposed geothermal fluid in different organic Rankine cycles for energy production. *Energy* 2020;193:116722. <https://doi.org/10.1016/j.energy.2019.116722>. ISSN 0360-5442.
- [34] Mahmoud Montaser, Ramadan Mohamad, Naher Sumsun, Keith Pullen, Abdul-Ghani Olabi. CO₂ – based transcritical Rankine cycle coupled with a ground-cooled condenser. *Therm Sci Eng Prog* 2021;25:100948. <https://doi.org/10.1016/j.tsep.2021.100948>. ISSN 2451-9049.
- [35] Vidhi Rachana, Yogi Goswami D, Elias Stefanakos. Supercritical rankine cycle coupled with ground cooling for low temperature power generation. *Energy Proc* 2014;57:524–32. <https://doi.org/10.1016/j.egypro.2014.10.206>. ISSN 1876-6102.
- [36] Abdul Ghani Olabi, Mahmoud Montaser, Soudan Bassel, Wilberforce Tabbi, Ramadan Mohamad. Geothermal based hybrid energy systems, toward eco-friendly energy approaches. *Renew Energy* 2020;147(Part 1):2003–12. <https://doi.org/10.1016/j.renene.2019.09.140>. ISSN 0960-1481.
- [37] Boukelia TE, Arslan O, Bouraoui A. Thermodynamic performance assessment of a new solar tower-geothermal combined power plant compared to the conventional solar tower power plant. *Energy* 2021;232:121109. <https://doi.org/10.1016/j.energy.2021.121109>. ISSN 0360-5442.
- [38] Formhals Julian, Feike Frederik, Hemmatabady Hoofar, Welsch Bastian, Sass Ingo. Strategies for a transition towards a solar district heating grid with integrated seasonal geothermal energy storage. *Energy* 2021;228:120662. <https://doi.org/10.1016/j.energy.2021.120662>. ISSN 0360-5442.
- [39] Rahbar Kiyarash, Mahmoud Saad, Raya K, Al-Dadah, Moazami Nima, Mirhadizadeh Seyed A. Review of organic Rankine cycle for small-scale applications. *Energy Convers Manag* 2017;134:135–55. <https://doi.org/10.1016/j.enconman.2016.12.023>. ISSN 0196-8904.
- [40] Capata Roberto, Hernandez Gustavo. Preliminary design and simulation of a turbo expander for small rated power organic rankine cycle (ORC). *Energies* 2014;7:7067–93. <https://doi.org/10.3390/en7117067>.